



Parking Area  
 Illuminance (Fc)  
 Average = 3.31  
 Maximum = 11.5  
 Minimum = 0.3  
 Avg/Min Ratio = 11.03  
 Max/Min Ratio = 38.33


Luminaire Schedule				
Scene: MH175				
Symbol	Label	LLF	Description	Lum. Watts
⊙	P10	0.638	LPQ175MA	175

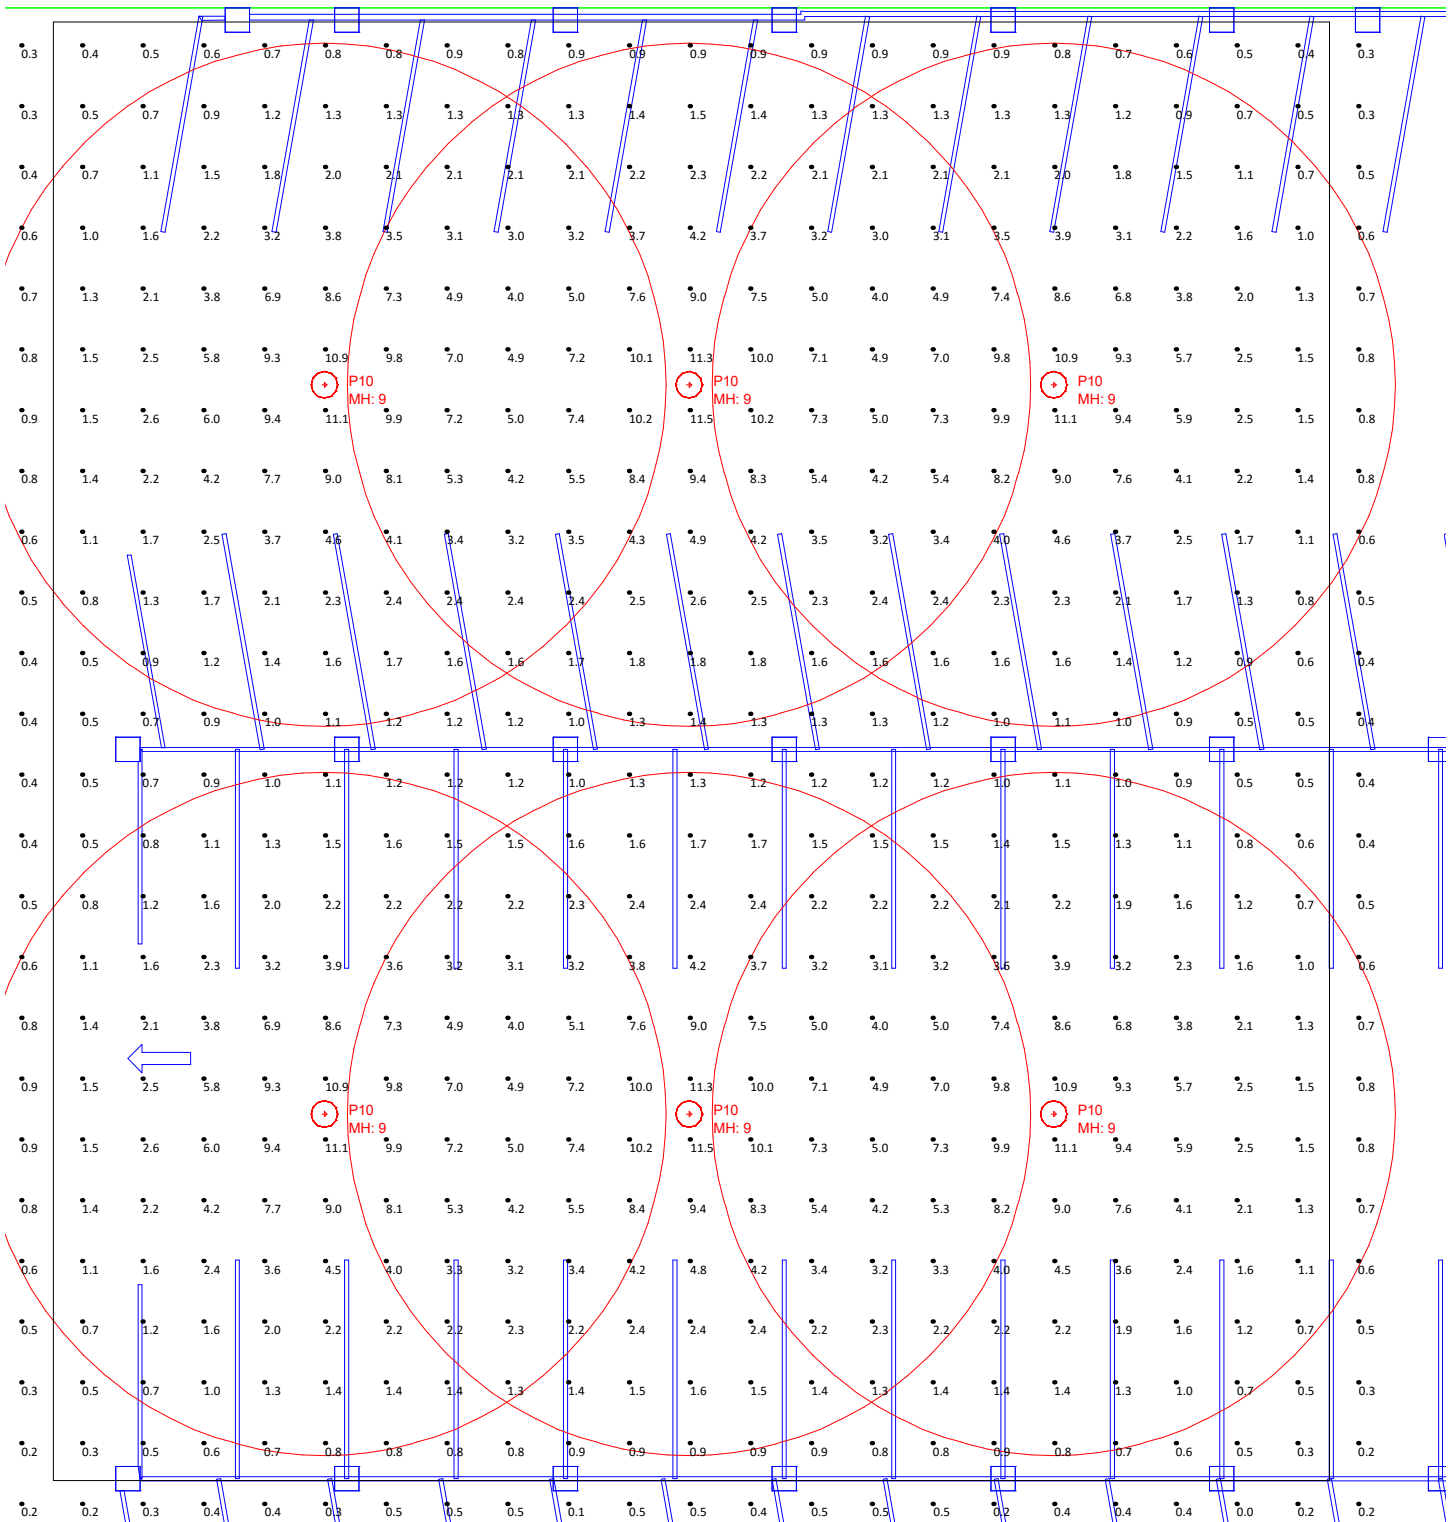


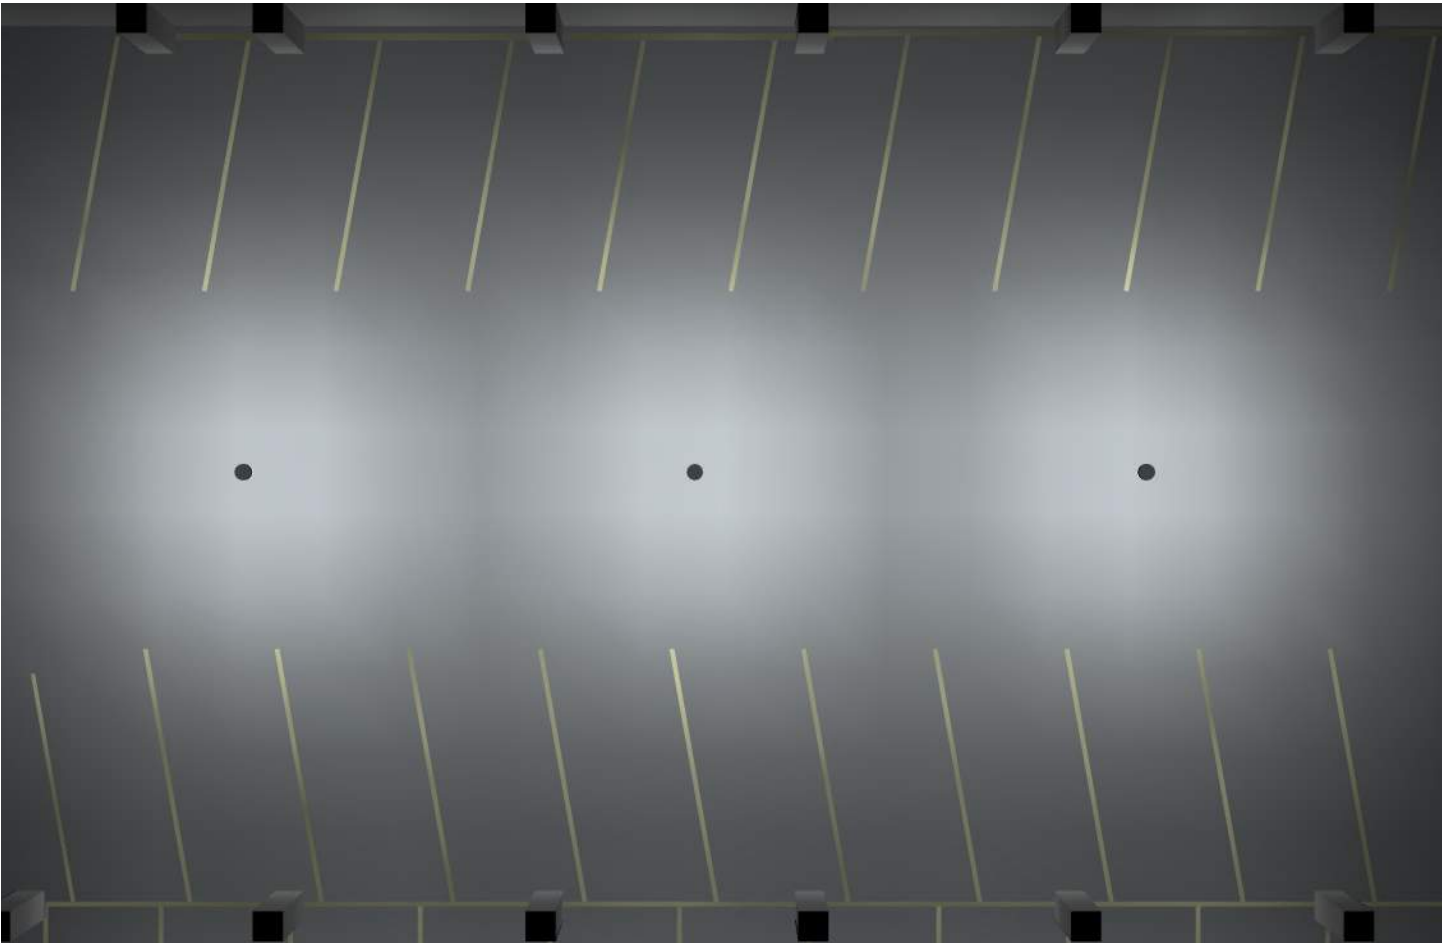


Parking Area  
 Illuminance (Fc)  
 Average = 3.04  
 Maximum = 11.5  
 Minimum = 0.3  
 Avg/Min Ratio = 10.13  
 Max/Min Ratio = 38.33


Luminaire Schedule				
Scene: Cree IG				
Symbol	Label	LLF	Description	Lum. Watts
+	P6	0.950	IG-NM-5S-J-57K-UL-xx-xxx	65.34

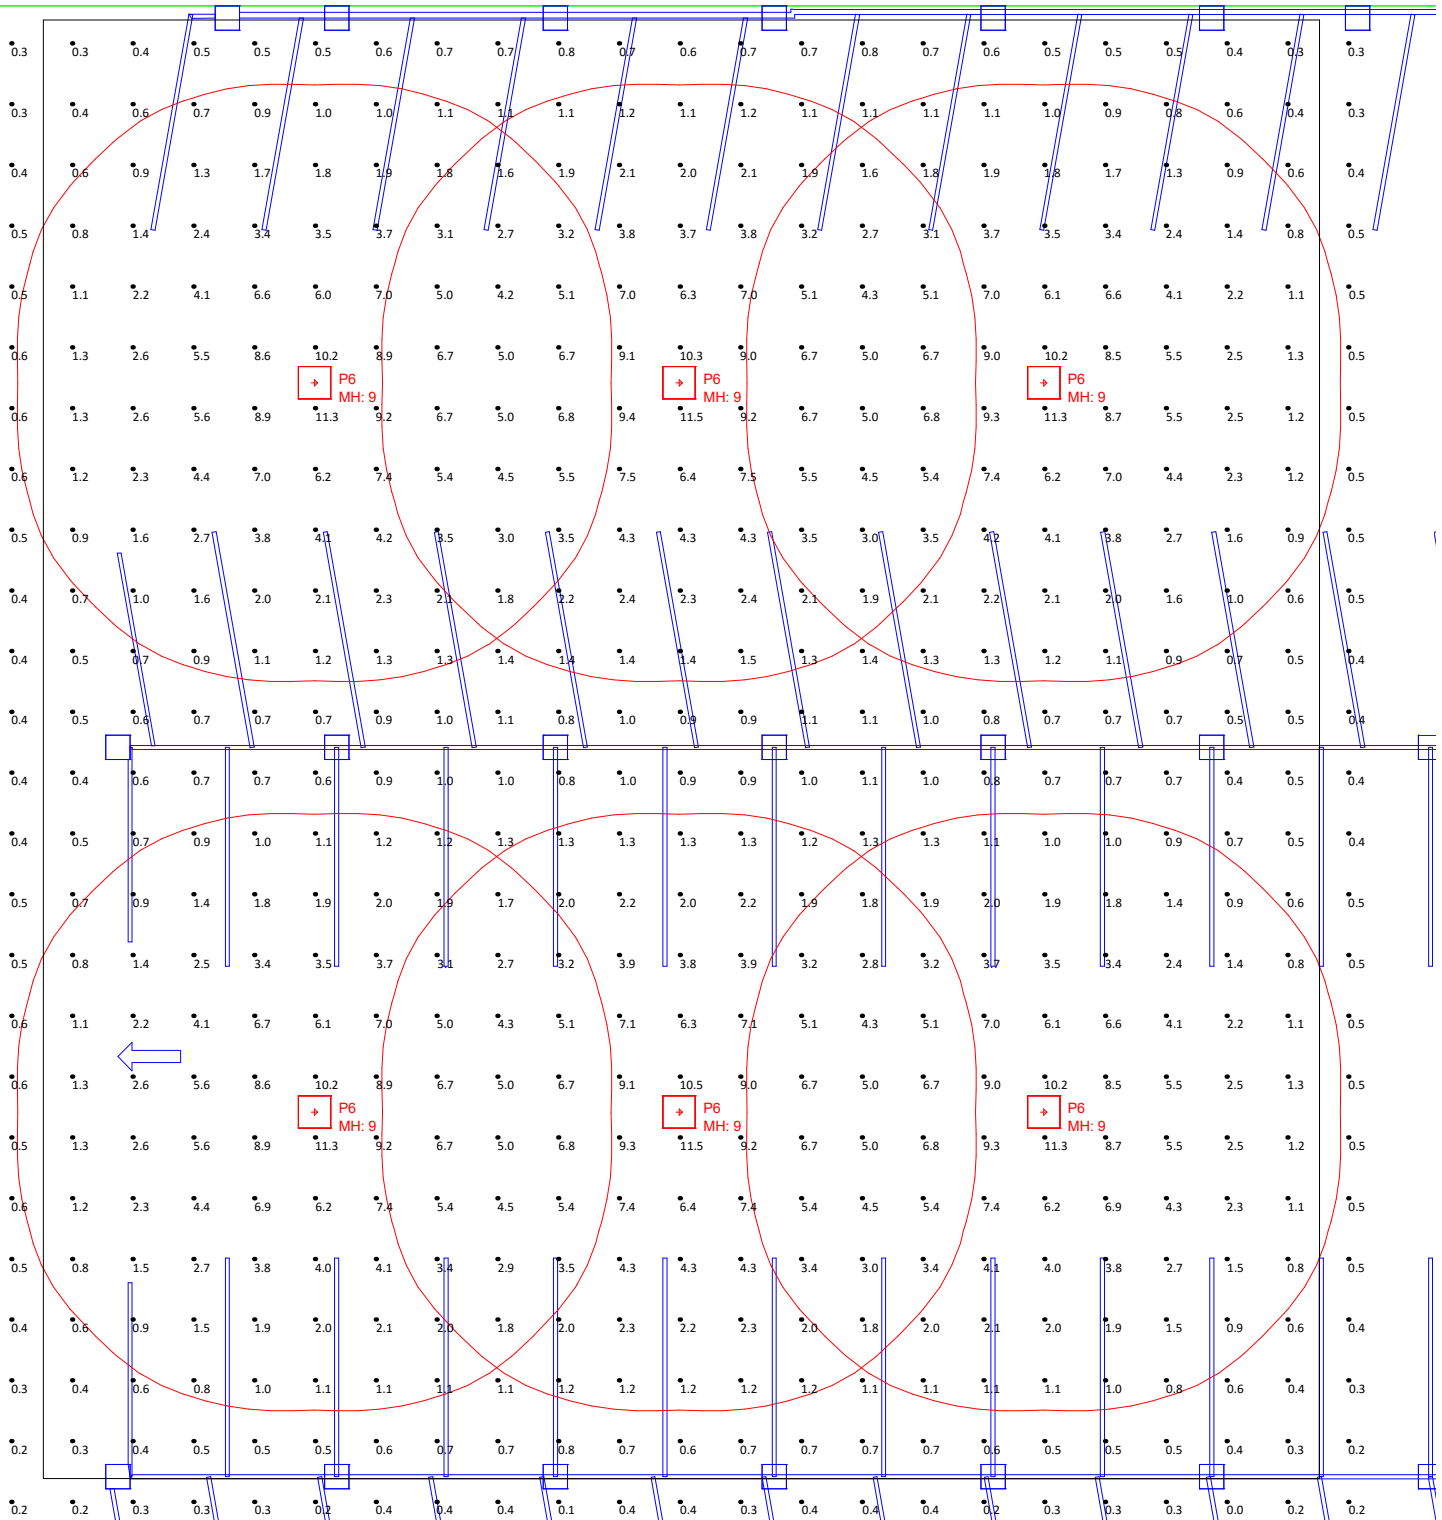


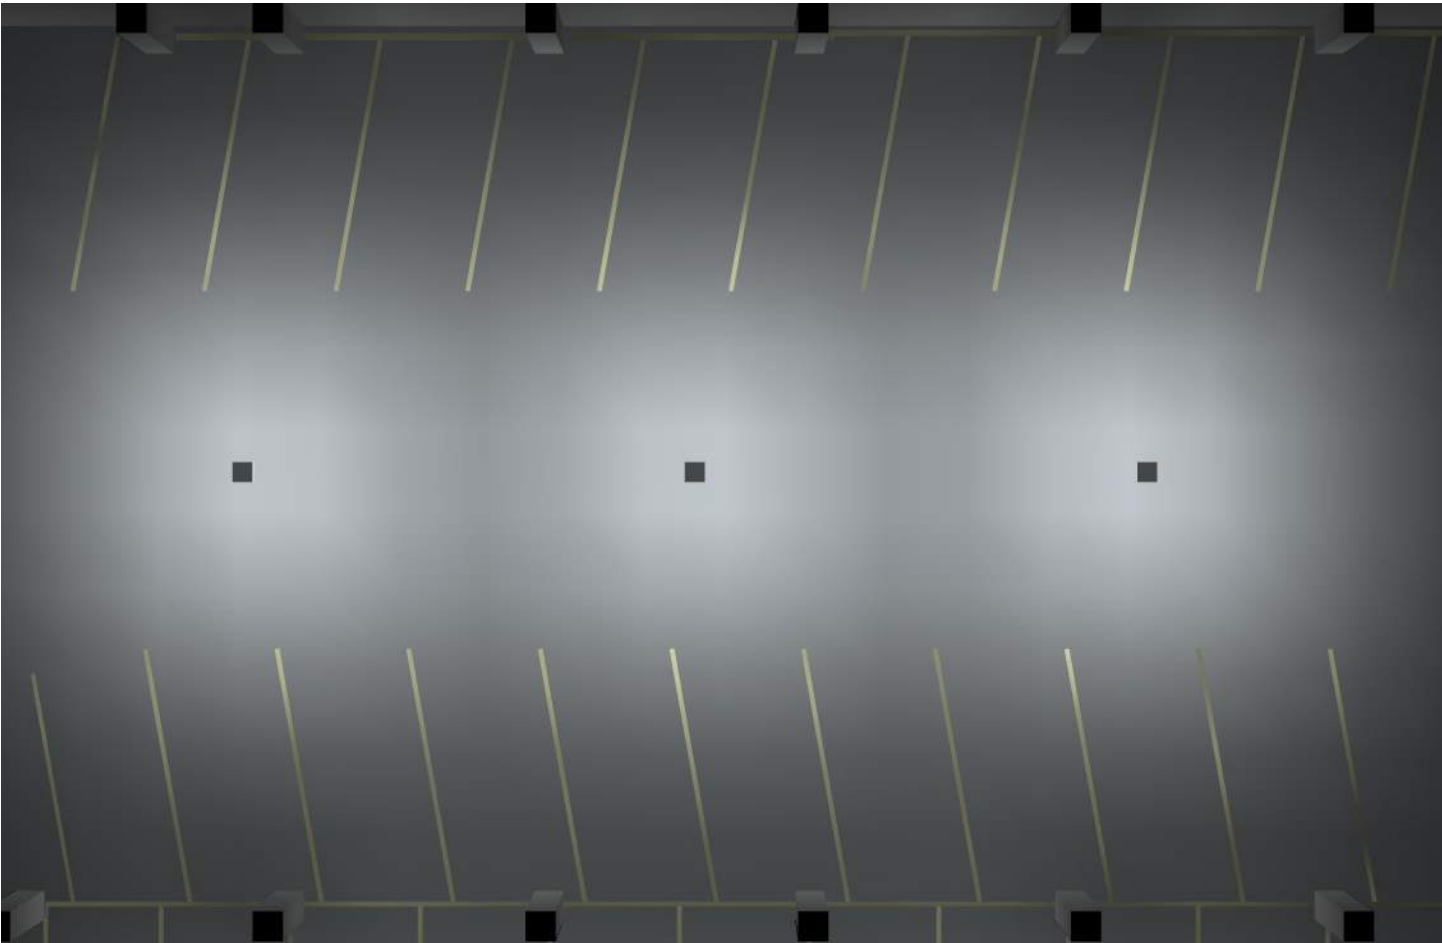


Parking Area  
 Illuminance (Fc)  
 Average = 3.40  
 Maximum = 9.2  
 Minimum = 0.4  
 Avg/Min Ratio = 8.50  
 Max/Min Ratio = 23.00


Luminaire Schedule				
Scene: SVPG				
Symbol	Label	LLF	Description	Lum. Watts
	P13	0.950	SVPG-168L-1800-NW-5	84.8

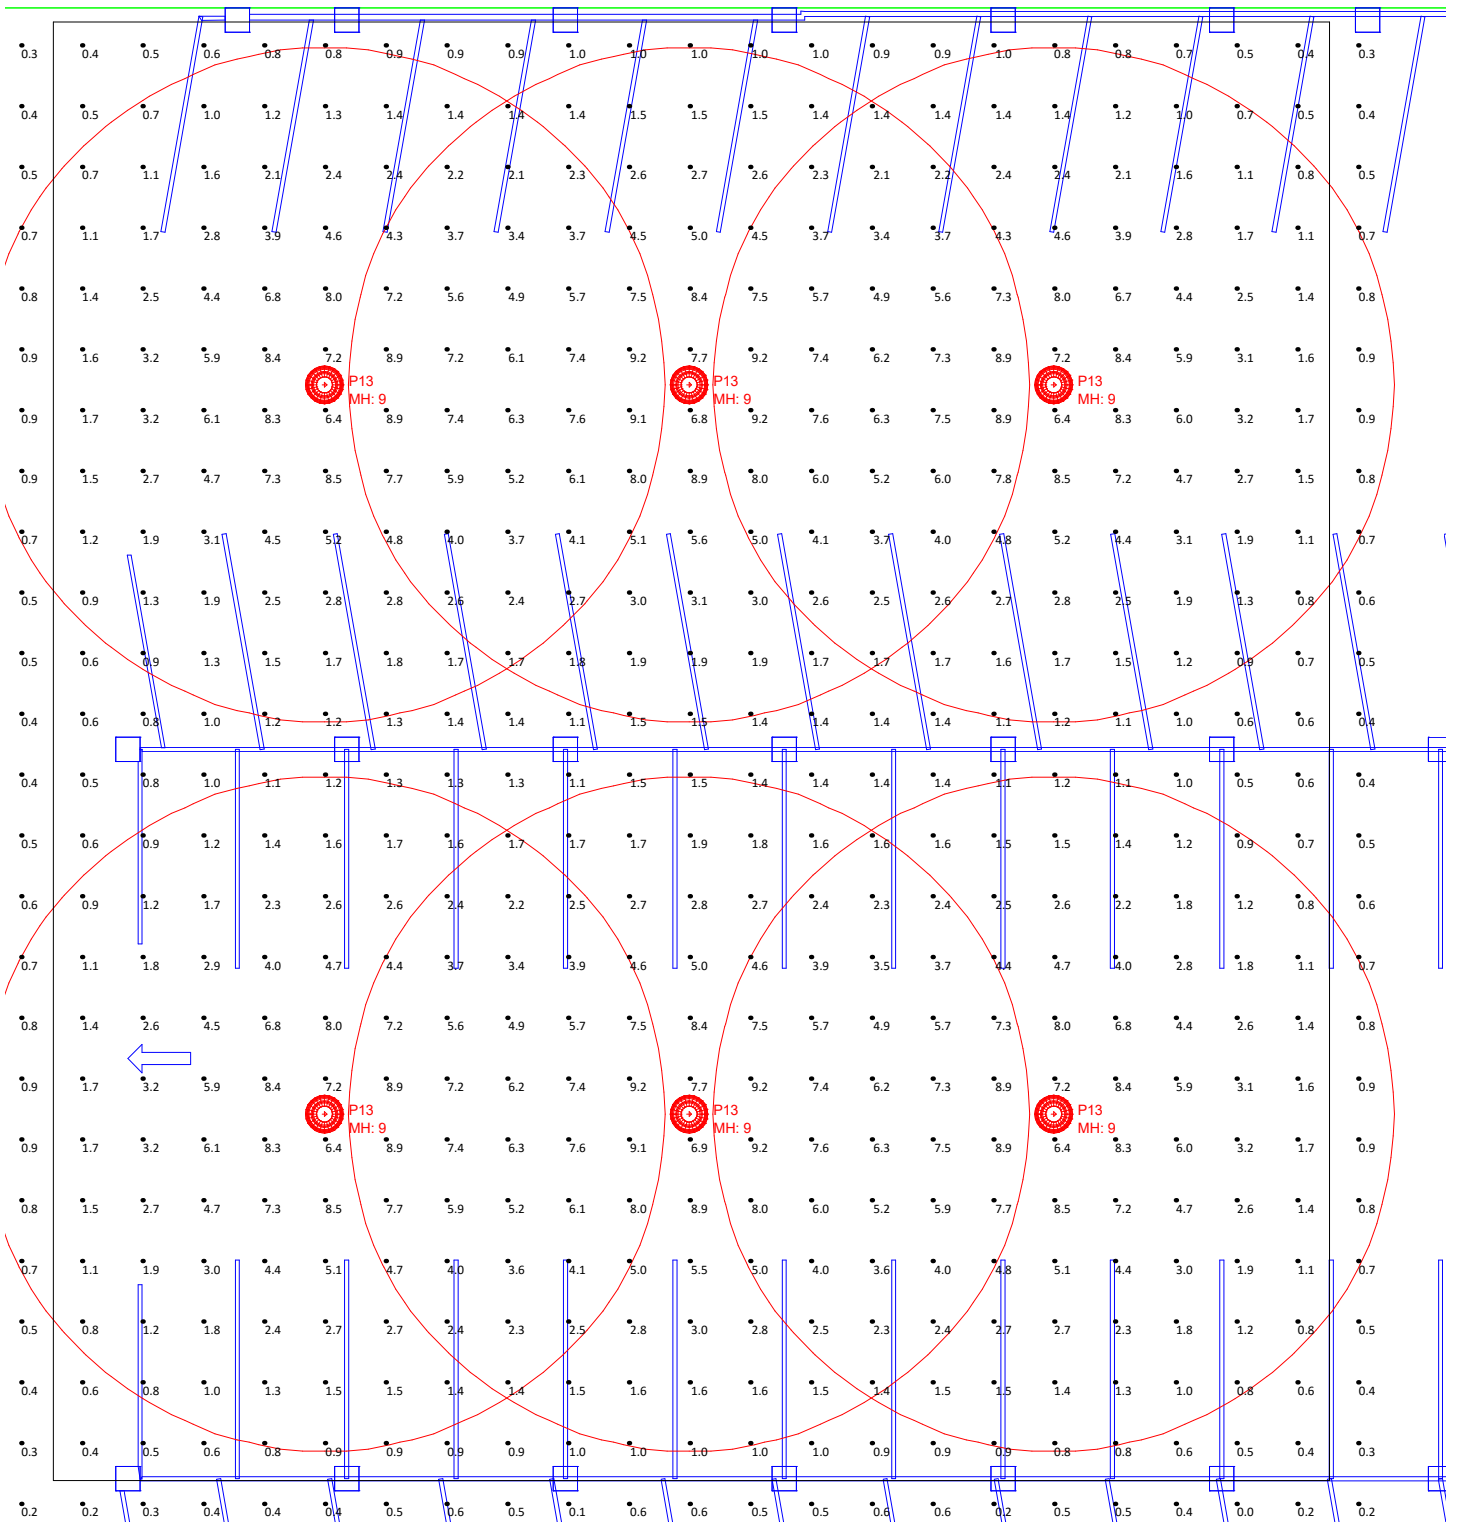


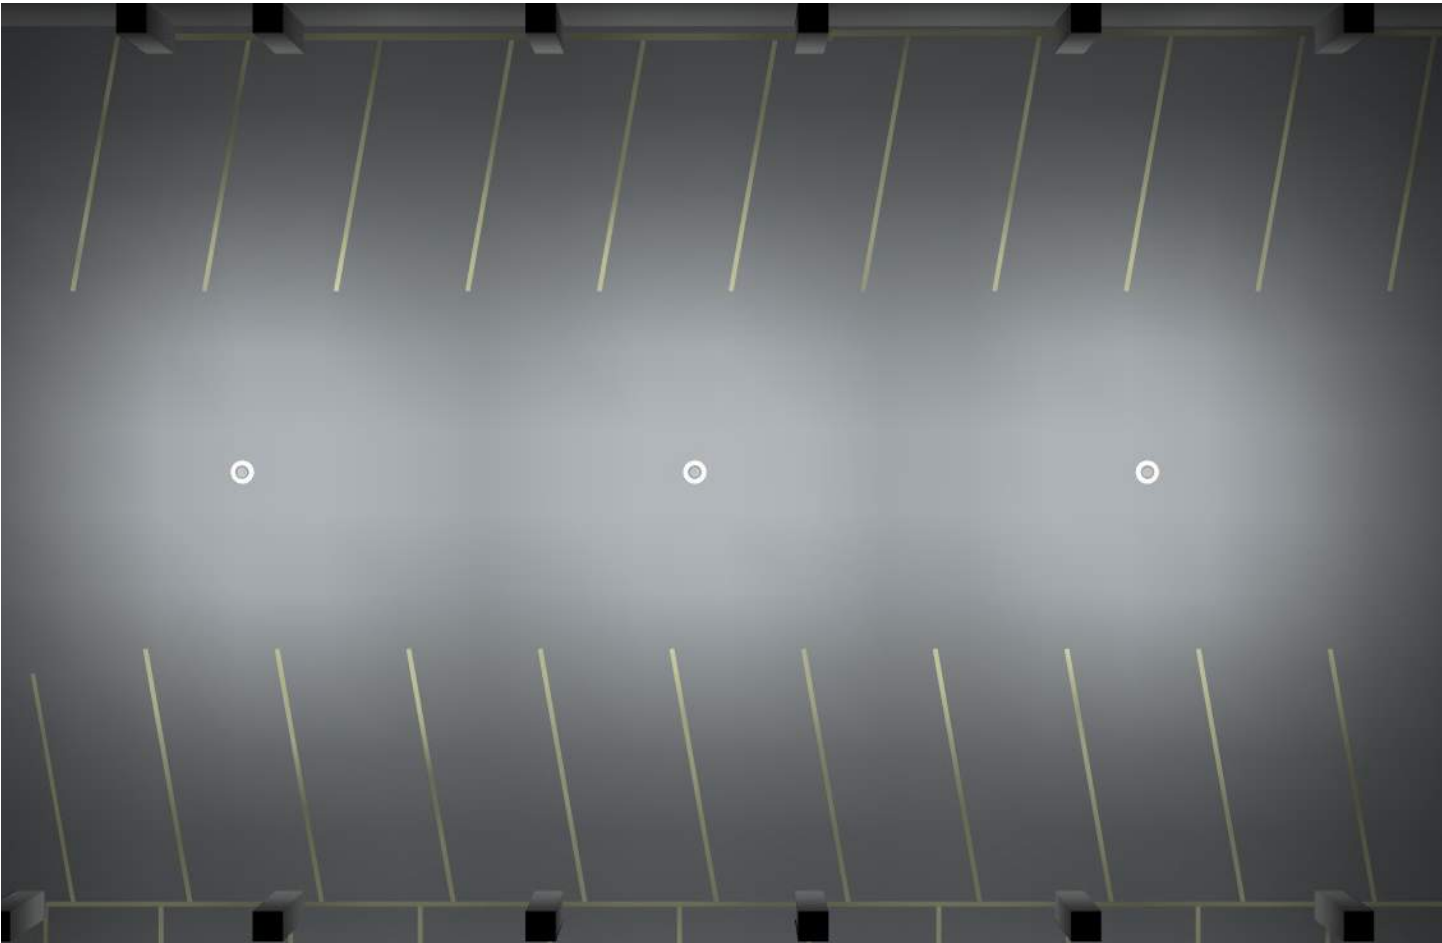

Parking Area  
 Illuminance (Fc)  
 Average = 2.74  
 Maximum = 11.4  
 Minimum = 0.2  
 Avg/Min Ratio = 13.70  
 Max/Min Ratio = 57.00

Luminaire Schedule				
Scene: SVPG				
Symbol	Label	LLF	Description	Lum. Watts
	P16	0.950	SVPG-168L-1200-NW-CD	54.4

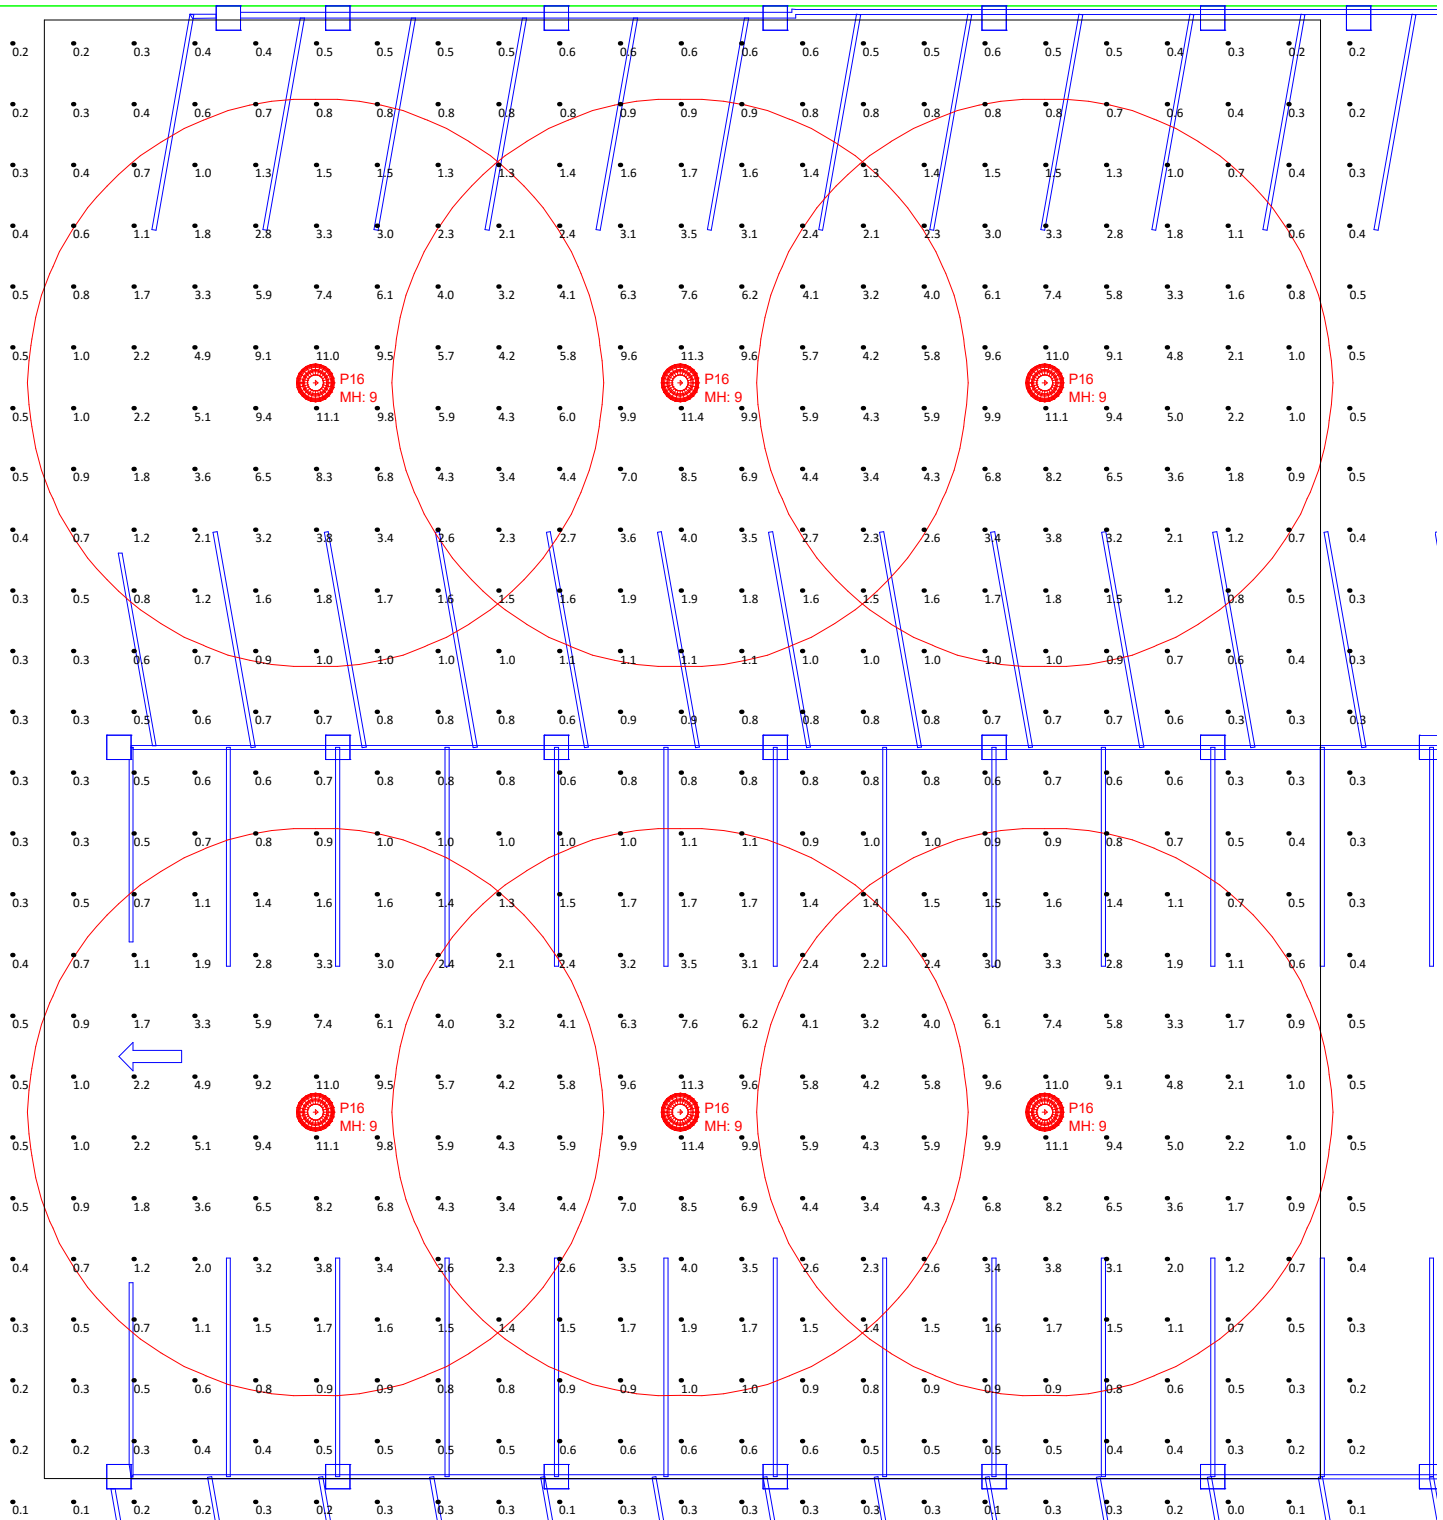

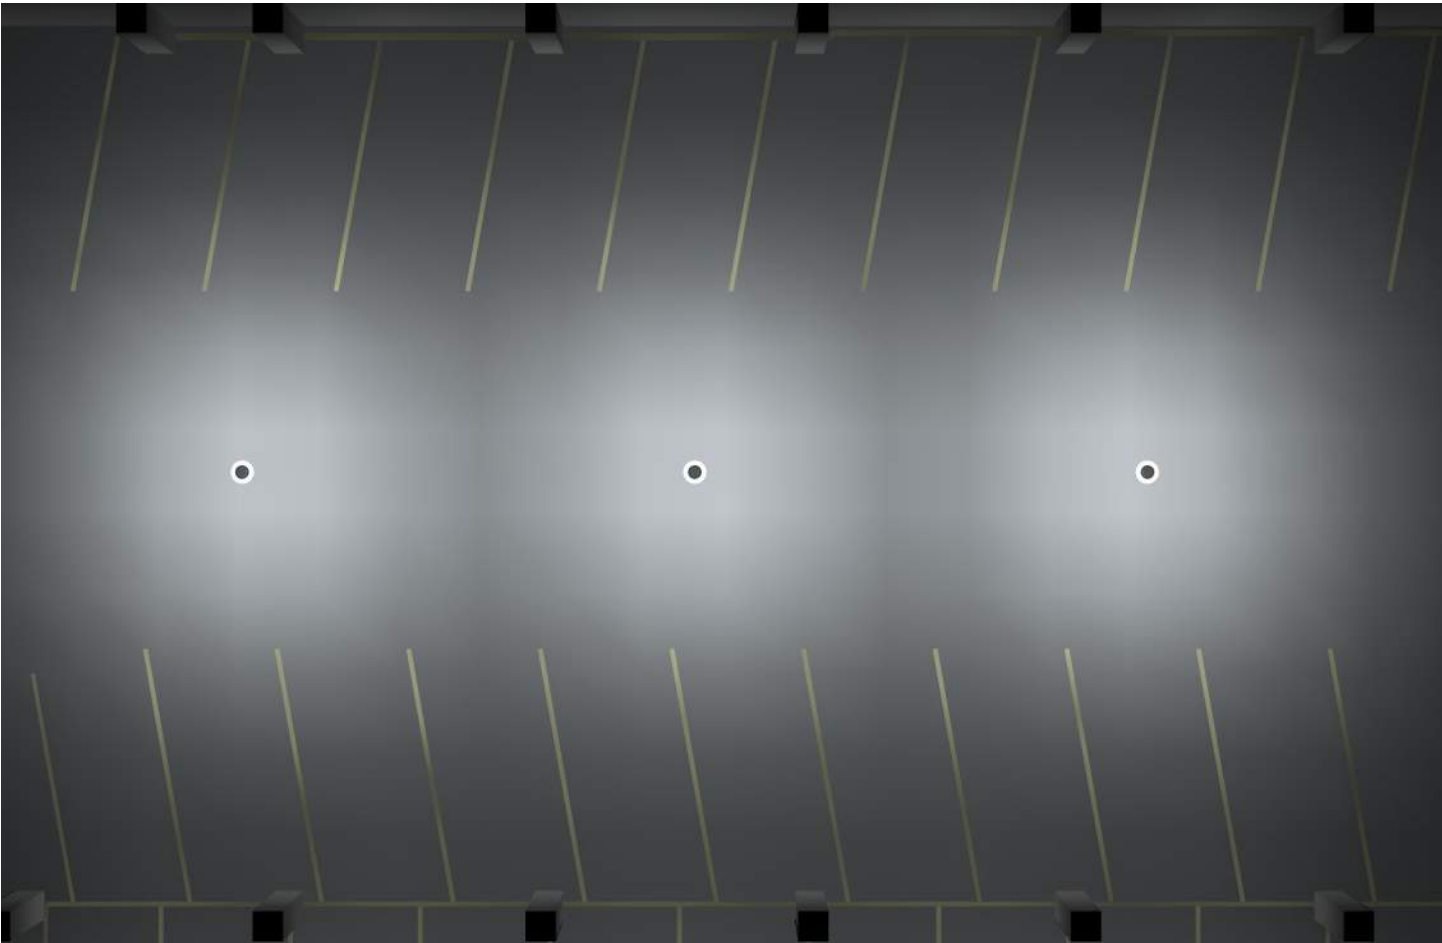



Parking Area  
 Illuminance (Fc)  
 Average = 2.93  
 Maximum = 6.9  
 Minimum = 0.4  
 Avg/Min Ratio = 7.33  
 Max/Min Ratio = 17.25

Luminaire Schedule				
Scene: G3				
Symbol	Label	LLF	Description	Lum. Watts
+	P2	0.950	G3-5-2-73LA-3270-NW	71.6

